## H7508B

# COMBINED OUTDOOR HUMIDITY TRANSMITTER / TEMPERATURE SENSOR





#### **GENERAL**

The H7508B Combined Outdoor Humidity Transmitter / Temperature Sensor incorporates a capacitive-type 3% relative humidity sensor with a 0..10 Vdc temperature output or NTC temperature sensor in one housing.

The H7508B can be used for control, indication and alarm monitoring in commercial or industrial installations.

#### **Models**

OS no.	temperature sensor type
H7508B1060	010 Vdc
H7508B1080	20kΩ NTC

#### **FEATURES**

- 0..10Vdc or 20kΩ NTC temperature sensing element
- · Wide sensing range
- Capacitance type sensing element for relative humidity
- Special housing for outside application

#### **SPECIFICATION**

#### General:

Power supply 24 Vac, +20...-30%; 50/60 Hz,

34 Vdc, +20...-30%

Current consumption 20 mA at 24 Vac / 50Hz Power consumption typ. 0.25 VA at 24Vac / 50Hz

typ. 0.1 W at 30 Vdc

Amb. operating limits -30...50 °C (-22...122 °F),

5...95% r.h., non-condensing (below 0 °C, the humidity measurement is

inaccurate)

Ambient storage limits -30...+70 °C (-13...+158 °F),

5...95% r.h., non-condensing

Dimensions see Fig. 3
Weight 130 g
Case plastic (ABS)

flame retardant as per UL94-HB Wall, surface, or wall outlet box

Mounting Wall, surface, or wall outlet by Protection Standard IP 34 as per EN 60529, Safety Class III as per EN 60730-1

**Temperature** 

Temp. sensing range: -30...50 °C (-22...158 °F)

**Nominal value** 

NTC  $20k\Omega$  20  $k\Omega$  at 25 °C

**Output signal** 

0..10 V proportional to -30 .. 50 °C

resolution ≤ 0.05 K

max. 2 mA sink/source current

short-circuit protected

**Accuracy** 

0..10 Vdc max.  $\pm 1.2$  K in range 5 .. 50 °C

NTC 20k $\Omega$  ±0.3 K at 25 °C

Response time

 $\begin{array}{ll} \text{0..10Vdc} & \tau_{\text{1/e}} < \text{1 min} \\ \\ \text{NTC 20k}\Omega & \tau_{\text{0.5}} < \text{11 min} \\ \end{array}$ 

**Relative Humidity** 

Hum. sensing range 5...95% r.h.

Output signal 0...10 V proportional to 0...100% r.h.

resolution ≤ 0.05% r.h.

max. 2 mA sink/source current

short-circuit protected

Accuracy class 3%

Temp. compensation in range 5 .. 50 °C

Accuracy (at 25 °C ambient)

5...10% r.h. ±10% 10...30% r.h. ± 5% 30...70% r.h. ± 3% 70...90% r.h. ± 5% 90...95% r.h. ±10%

Response time

Response time  $\tau_{0.9}$  < 20 s

## INSTALLATION Wiring

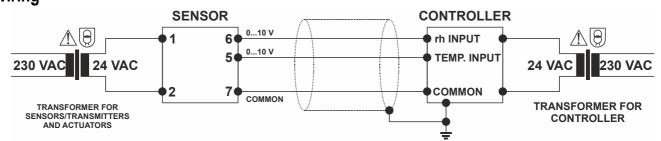


Fig. 1. Wiring example, H7508B1060

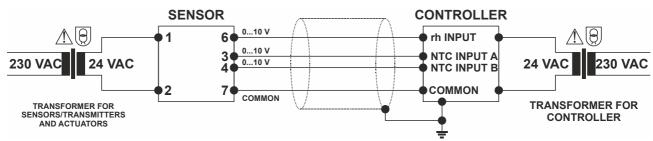


Fig. 2. Wiring example, H7508B1080

**Table 1. Terminal assignment** 

<b>v</b>		
Terminal #	H7508B1060	H7508B1080
1	24 V ~ (AC or positive DC power supply)	24 V ~ (AC or positive DC power supply)
2	24 V <sup>⊥</sup> (AC common or negative DC power supply)	24 V <sup>⊥</sup> (AC common or negative DC power supply)
3	Not connected	NTC 20 kΩ
4		
5	Temperature output 010 V	Not connected
6	Humidity output 010 V	Humidity output 010V
7	COM = 24 V <sup>⊥</sup>	COM = 24 V <sup>⊥</sup>
8		
9	Not connected	Not connected
10		

**NOTE:** Use two separate safety transformers, one for sensors/transmitters and actuators and one for the controller (see Fig. 1).

Accepted wires are solid/stranded 0.34 ... 1.3 mm<sup>2</sup> (AWG 22 ...16), max. terminal screw tightening torque: 0.5 Nm (4.4 lb-in).

Max. wire length is 200 m (660 ft) between the transmitter and the controller.

Keep 15 cm (5.9") min. distance between sensor lines and 230 Vac power lines.

Installation of the product near high EMI-emitting devices may lead to faulty measurements. Use shielded wiring in areas with high EMI.

### **Mounting Advice**

- Mount the product where it is protected against rain and direct sun radiation, preferably on the north side of the building. If
  this is not practical, it should be shielded from the sun's rays.
- Mount the product preferably on that outside wall of the buildings having windows of the main occupancy rooms to be controlled.
- Provide sufficient air circulation for accurate measurement.
- to avoid false measurement due to warm air drafts from the conduit, seal the cable conduit.
- To prevent rain water from entering the sensor housing, ensure that the cable inlet holes on the product housing are sealed properly and that the cable runs from the bottom to the top into the cable entry.
- Do not mount the product over windows, doors, air extractors, or other heat sources or underneath the eaves of the roofs or a balcony.

### **DIMENSIONS**

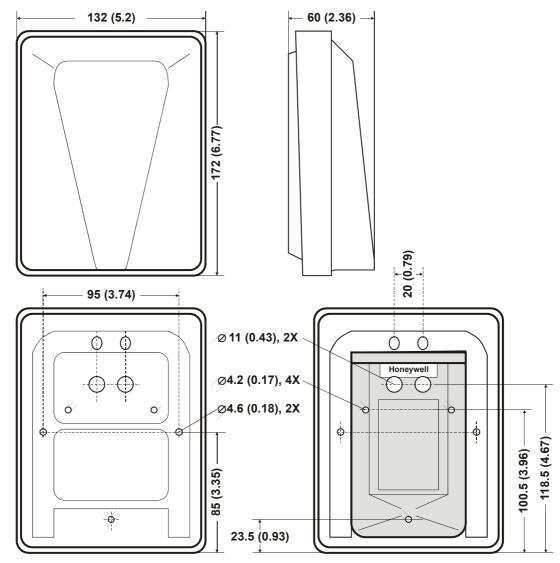


Fig. 3. Dimensions of special housing in mm (inches)

## Honeywell

Manufactured for and on behalf of the Environmental and Combustion Controls Division of Honeywell Technologies Sarl, Rolle, Z.A. La Pièce 16, Switzerland by its Authorized Representative:

#### **Automation and Control Solutions** Honeywell GmbH

Honeywell GmbH Böblinger Strasse 17 71101 Schönaich Germany

Phone: (49) 7031 63701 Fax: (49) 7031 637493 http://ecc.emea.honeywell.com

Subject to change without notice. Printed in Germany

EN0B-0179GE51 R0313